




TRUSS BEARING ELEVATION PLAN

SCALE: 1/32" = 1'-0"

THIS DETAIL DENOTES THE TRUSS BEARING ELEVATION AT EACH AREA OF THE BUILDING. FOR CEILING ELEVATIONS REFER TO ARCHITECTURAL, REFLECTED CEILING PLAN.

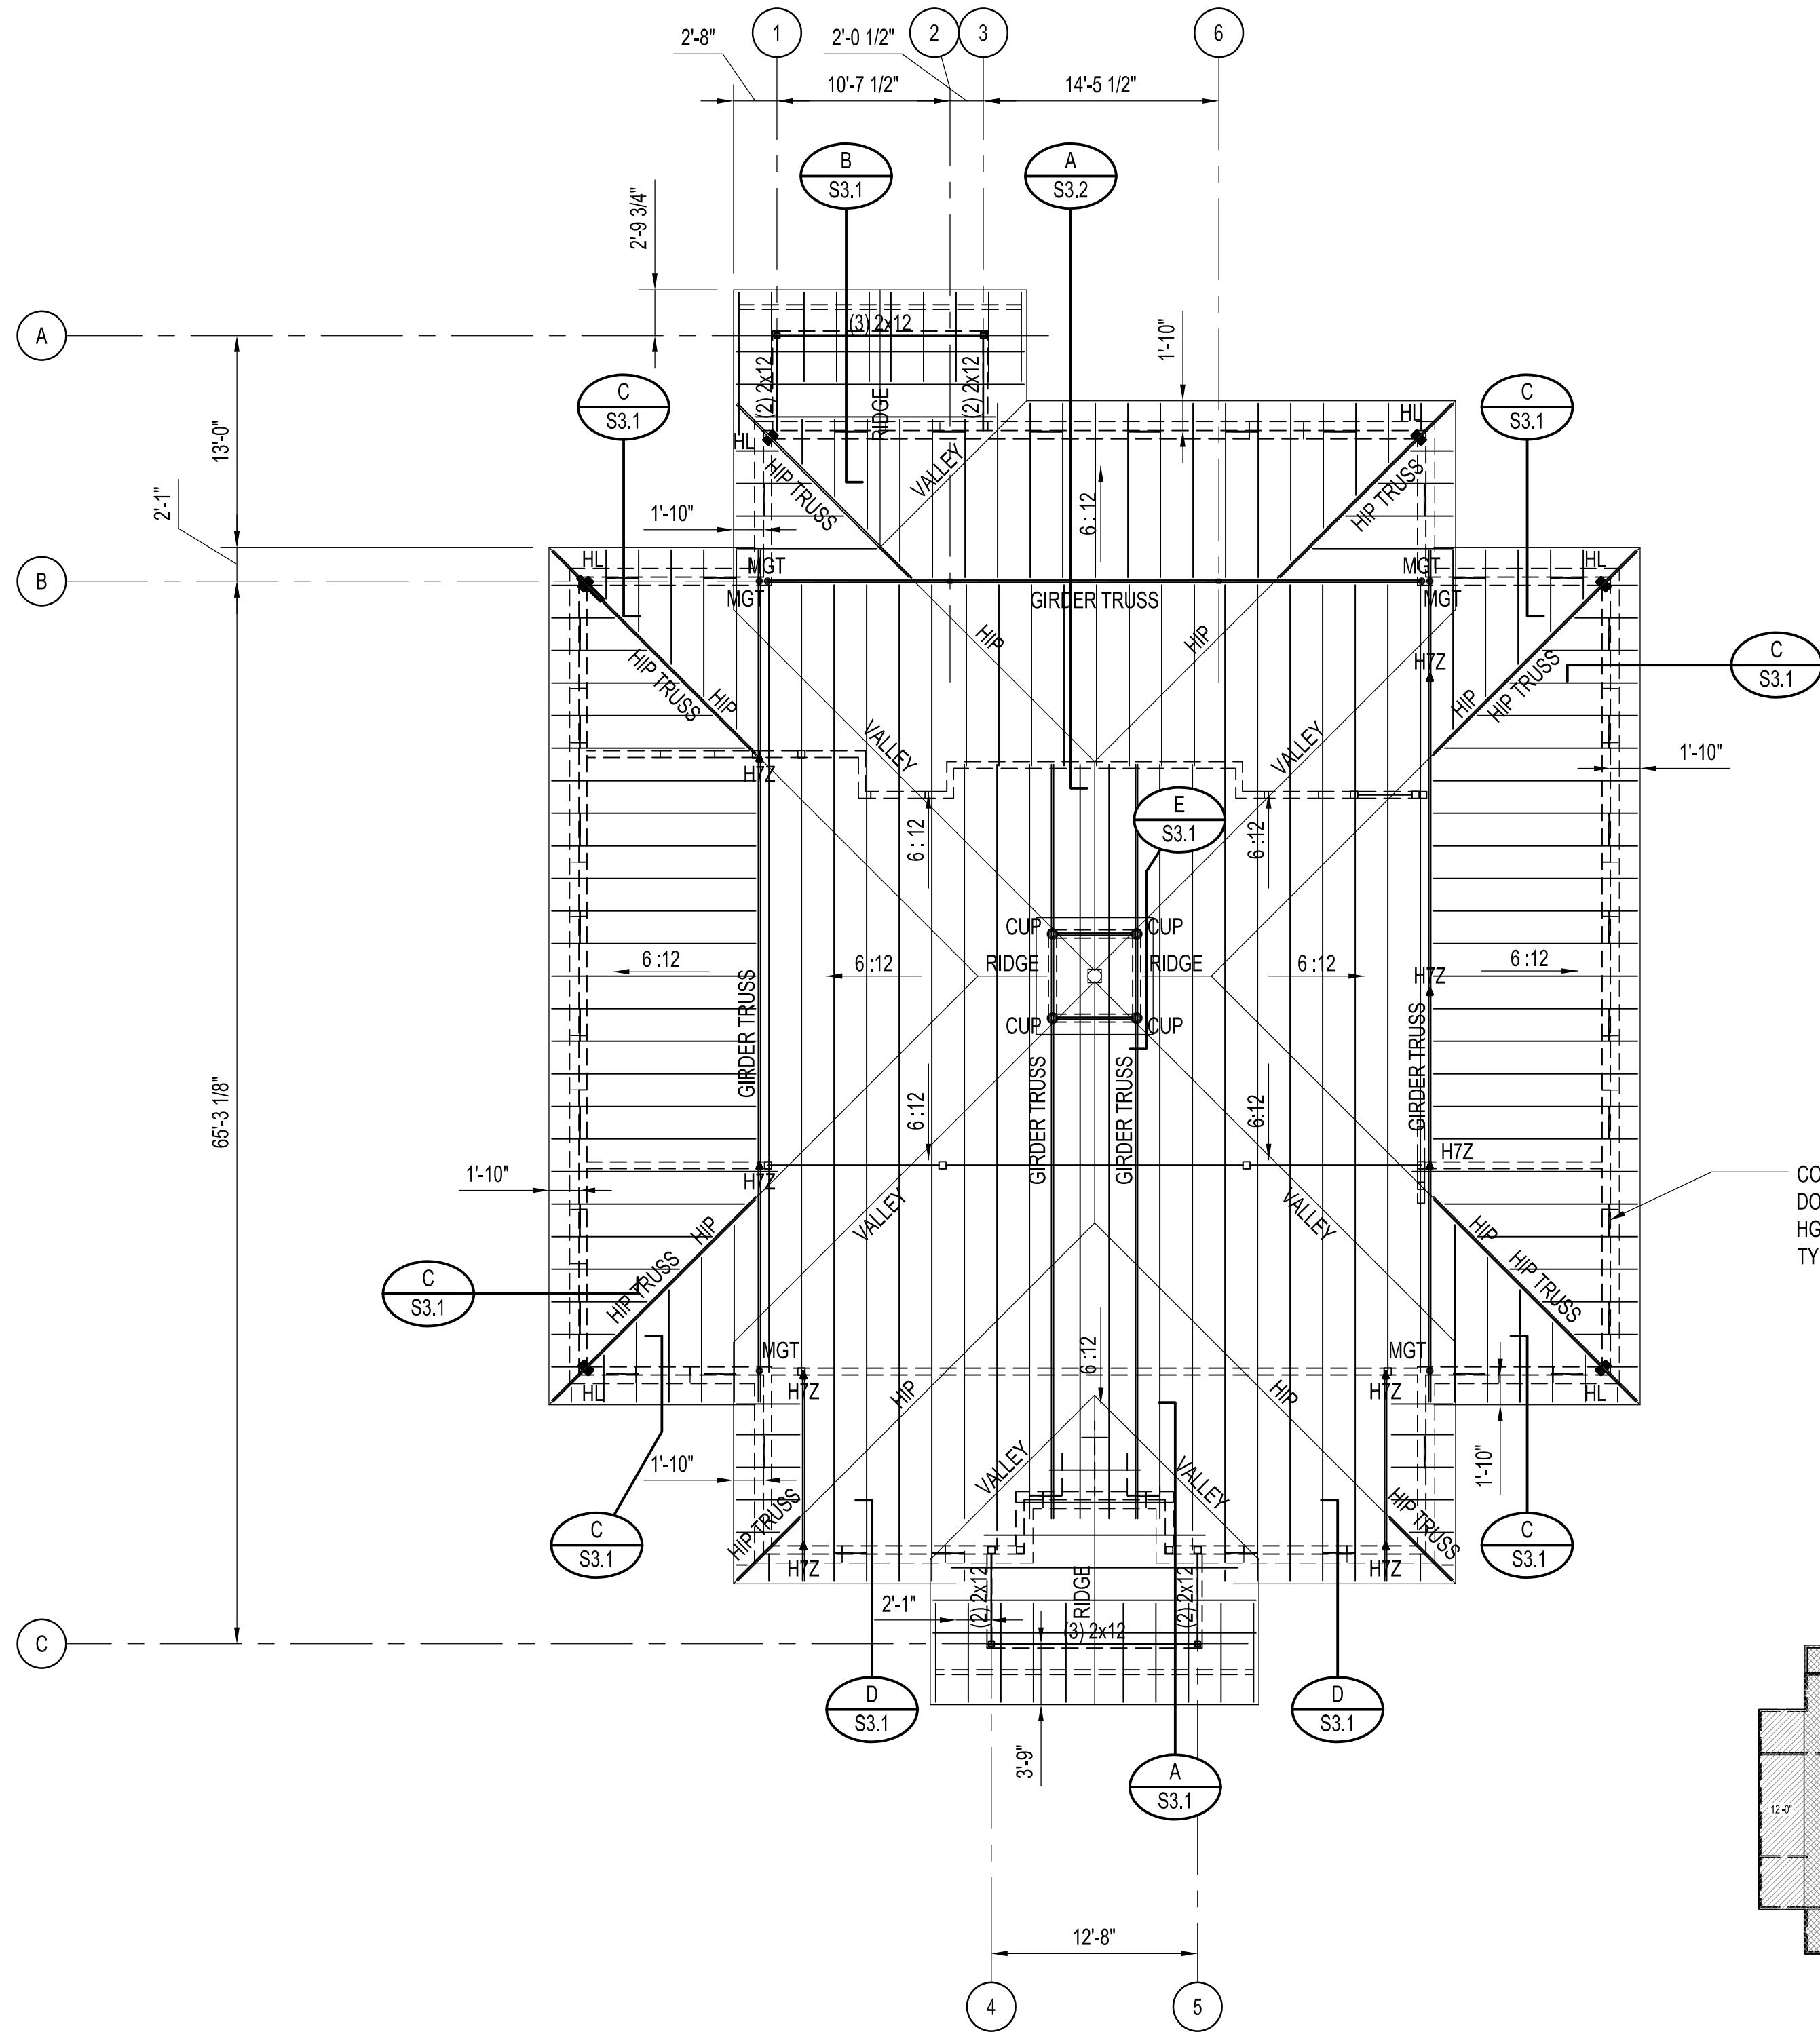

ROOF FRAMING PLAN

SCALE: 1/8" = 1'-0"

PLAN NOTES:

1. TRUSS BEARING IS 12'-0" UNLESS NOTED OTHERWISE.
2. ROOF FRAMING TO BE ENGINEERED WOOD TRUSSES AT 24" O.C. REFER TO GENERAL NOTES FOR REQUIRED LOADING.
3. ROOF DECKING TO BE 5/8" PLYWOOD/OSB. CONNECT ROOF DECKING TO SUPPORTING STRUCTURE WITH 8d NAILS SPACED AT 4" O.C. AROUND THE PERIMETER AND AT 12" O.C. IN THE INTERIOR FIELD. ALL ROOF SHEATHING PANELS EDGES TO BE BLOCKED WITH 2x4.
4. THE FOLLOWING INFORMATION IS PROVIDED FOR CLARIFICATION:
 - OUTLOOKERS 2x4 AT 24" O.C. WITH BLOCKING BETWEEN OUTLOOKERS: CONNECT BLOCKING TO DOUBLE TOP PLATE WITH SIMPSON A34 CLIP OR (4) #10 x 3" WOOD SCREWS.
5. MINIMUM TRUSS UPLIFT CONNECTOR TO BE SIMPSON H2.5A AT ALL BEARING WALLS.
6. ALL NON-TRUSS ROOF FRAMING TO BE NO. 2 SOUTHERN PINE.
7. STANDARD CORNER ASSEMBLIES ARE ACCEPTABLE AT INSIDE AND OUTSIDE CORNERS.
8. DESIGNATES A GIRDER TRUSS HOLD-DOWN: SIMPSON MGT, INSTALLED PER MANUFACTURER'S GUIDE LINES, SEE DETAIL ON S-2.1.
9. DESIGNATES A GIRDER TRUSS HOLD-DOWN: SIMPSON H7Z, INSTALLED PER MANUFACTURER'S GUIDE LINES, SEE DETAIL ON S-2.1.
10. DESIGNATES A QUADRUPLE HEAVY ANGLE HOLD-DOWN: FASTEN GIRDER TRUSS TO TOP PLATE WITH (2) HL35 AND TOP PLATE TO POST WITH (2) HL35, INSTALL ALL HL35 PER MANUFACTURER'S GUIDE LINES, SEE DETAIL ON S-2.1.
11. FASTEN ALL ROOF TRUSSES AT EACH BEARING LOCATION WITH H2.5A SIMPSON HOLD DOWN, UNLESS NOTED OTHERWISE.
12. DENOTES CUPOLA CONNECTION POINTS, SEE SECTION F/S3.1. CUPOLA BY CAMPBELLSVILLE INDUSTRIES, SEE MANUFACTURER'S TYPE "H-3" ANCHOR DETAIL FOR ADDITIONAL FRAMING REQUIREMENTS.