


NAILING SCHEDULE		
CONNECTION	FASTENING	LOCATION
JOIST TO SILL OR GIRDER	3 - 3"x0.131"	TOENAIL
	3 - 8d	
	2 - 16d	
BRIDGING TO JOIST	2 - 3"x0.131"	TOENAIL EACH END
	2 - 8d	
BOTTOM PLATE TO JOIST OR BLOCKING	3"x0.131" @ 8" o.c. 16d @ 16" o.c.	TYPICAL FACE NAIL
BOTTOM PLATE TO JOIST OR BLOCKING AT SHEARWALL	4 - 3"x0.131" @ 8" o.c. 3 - 16d @ 16" o.c.	TYPICAL FACE NAIL
TOP PLATE TO STUD	3 - 3"x0.131"	END NAIL
	2 - 16d AT 2x4 STUDS	
	3 - 16d AT 2x6 STUDS	
BOTTOM PLATE TO STUD	3 - 3"x0.131"	END NAIL
	2 - 16d AT 2x4 STUDS	
	3 - 16d AT 2x6 STUDS	
CONTINUOUS HEADER TO STUD	4 - 3"x0.131"	TOENAIL
	4 - 8d	TOENAIL
BUILT-UP CORNER STUDS	3"x0.131" @ 12" o.c. 16d @ 16" o.c.	FACE NAIL
	3"x0.131" @ 8" o.c., STAGGERED 16d @ 12" o.c., STAGGERED	FACE NAIL
DOUBLE STUDS	3"x0.131" @ 8" o.c., STAGGERED 16d @ 12" o.c., STAGGERED	FACE NAIL
DOUBLE TOP PLATES	3"x0.131" @ 12" o.c. 16d @ 16" o.c.	TYPICAL FACE NAIL
DOUBLE TOP PLATE SPLICE	12 - 3"x0.131" 10 - 16d	FACE NAIL EA. SIDE OF SPLICE
TOP PLATE INTERSECTIONS	4 - 3"x0.131"	FACE NAIL
	3 - 16d	
RIM JOIST TO JOIST	5 - 3"x0.131" 3 - 16d	END NAIL
RIM JOIST TO TOP PLATE	3"x0.131" @ 12" o.c. 8d @ 6" o.c.	TOENAIL
BLOCKING BETWEEN JOISTS OR RAFTERS TO TOP PLATE	4 - 3"x0.131"	TOENAIL
	4 - 8d	
CEILING JOISTS TO PARALLEL RAFTERS	12 - 3"x0.131" 10 - 16d	FACE NAIL
CEILING JOISTS, LAPS OVER WALLS OR BEAMS	12 - 3"x0.131" 10 - 16d	FACE NAIL
CEILING JOIST TO PLATE	5 - 3"x0.131" 3 - 8d	TOENAIL
RAFTER TO PLATE	3 - 3"x0.131" 3 - 8d	TOENAIL
BUILT-UP HEADERS, BEAMS, AND GIRDER (3-PLY MAXIMUM) 16d	3"x0.131" @ 12" o.c. & 3 @ ENDS @ 16" o.c. & 3 @ ENDS	FACE NAIL TOP & BOTTOM & STAGGER OPPOSITE SIDES
	3"x0.131" @ 6" o.c., STAGGERED 16d @ 8" o.c., STAGGERED	FACE NAIL
COLLAR TIE TO RAFTER	6 - 3"x0.131" 4 - 16d	FACE NAIL
JACK RAFTER TO HIP	4 - 3"x0.131"	TOENAIL
	3 - 10d	
	3 - 3"x0.131" 2 - 16d	FACE NAIL
ROOF RAFTER TO 2x RIDGE	4 - 3"x0.131"	TOENAIL
	3 - 16d	
	3 - 3"x0.131" 2 - 16d	END NAIL
SUBFLOOR (PLYWOOD OR OSB) TO FRAMING	8d RING SHANK	@ 6" o.c. AT PANEL EDGES & 12" o.c. AT INTERMED. SUPPORTS
ROOF SHEATHING (PLYWOOD OR OSB) TO FRAMING	8d RING SHANK	@ 4" o.c. AT PANEL EDGES & 12" o.c. AT INTERMED. SUPPORTS
EXTERIOR & SHEARWALL SHEATHING TO FRAMING (PLYWOOD OR OSB)	8d RING SHANK	@ 4" o.c. AT PANEL EDGES & 12" o.c. AT INTERMED. SUPPORTS
CELLULOSE FIBERBOARD SHEATHING TO FRAMING	8d	@ 3" o.c. AT PANEL EDGES & 6" o.c. AT INTERMED. SUPPORTS
1/2" GYPSUM BOARD TO FRAMING	6d NAILS OR 1 1/4" SCREWS	@ 7" o.c.
5/8" GYPSUM BOARD TO FRAMING	8d NAILS OR 1 5/8" SCREWS	@ 7" o.c.
1/4" OR 3/8" INT. WOOD PANELING	6d CASING OR FINISH NAILS	@ 6" o.c. AT PANEL EDGES & 12" o.c. AT INTERMED. SUPPORTS
1"x6" PLANKS TO EACH JOIST	2 - 8d	FACE NAIL
2" PLANKS TO EACH JOIST	2 - 16d	FACE NAIL


SCHEDULE NOTES:
 1. THIS NAILING SCHEDULE APPLIES TO ALL WOOD FRAMING AND ROUGH CARPENTRY AND REPRESENTS THE MINIMUM ACCEPTABLE CONNECTIONS, UNLESS ADDITIONAL OR ALTERNATE CONNECTIONS ARE REQUIRED OR SPECIFIED IN THE SECTIONS, TYPICAL DETAILS, GENERAL NOTES OR SPECIFICATIONS.
 2. NAILS ARE SMOOTH COMMON UNLESS NOTED OTHERWISE.
 3. JOIST NAILING SHALL BE USED WHERE FLOOR TRUSSES OCCUR INSTEAD, BUT NOT LESS THAN THE TRUSS SUPPLIER'S RECOMMENDED MINIMUM ATTACHMENT PATTERN.
 4. RAFTER NAILING SHALL BE USED WHERE ROOF TRUSSES OCCUR INSTEAD, BUT NOT LESS THAN THE TRUSS SUPPLIER'S RECOMMENDED MINIMUM ATTACHMENT PATTERN.

(WOOD OPTION)


STEEL COLUMN SCHEDULE		
COLUMN DESIGNATION	A - 1, A - 3 D - 4, D - 7	B - 2, B - 8
CAP PLATE	3/8" SADDLE	3/8" SADDLE
TRUSS BEARING +(14'-8")		
TRUSS BEARING +(13'-11")		
BEAM BEARING +(13'-8 1/2")		
TRUSS BEARING +(12'-0")		
FIRST FLOOR (0'-0")	HSS4x4x1/4	HSS4x3x1/8
BASE PLATE SIZE (IN)	10 x 10 x 3/4	10 x 10 x 3/4
BASE PLATE TYP. DETAIL	CBP1	CBP1
ANCHOR BOLT (A307 OR A36)	(4) 3/4"	(4) 3/4"
ANCHOR BOLT TYP. DETAIL	AB1	AB1
PEDESTAL SIZE (IN)		
VERTICAL BARS		
TIES		
TOP OF PEDESTAL ELEV.		
REMARKS	CAP PLATE TO BE 3/8" SADDLE TO RECEIVE (3) 2x12 WOOD BEAM.	CAP PLATE TO BE 3/8" SADDLE TO RECEIVE WOOD TRUSS GIRDER.

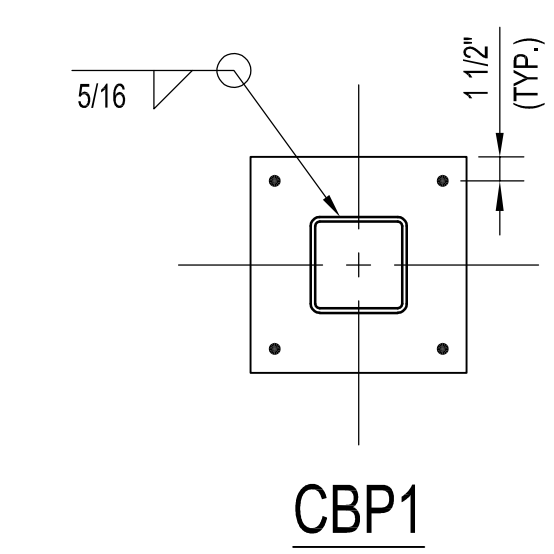

CBP1

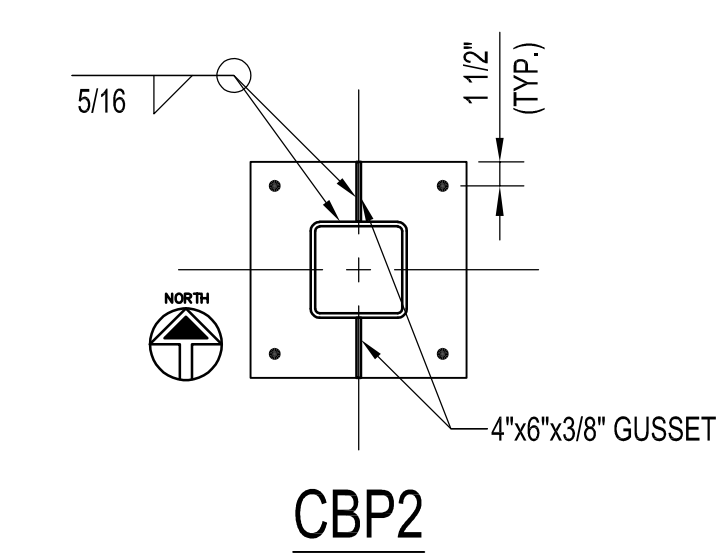

CBP2

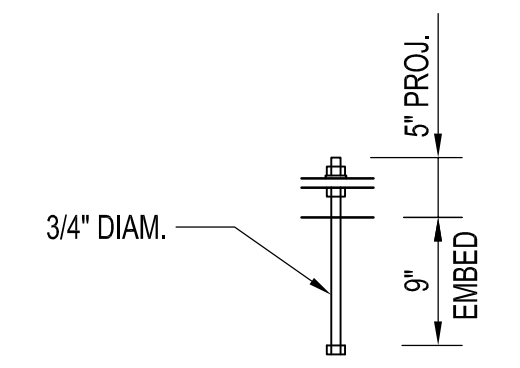

AB1

TENSION LAP SPLICE LENGTHS								
BAR SIZE	f _c 3000 PSI				f _c 4000 PSI			
	TOP BARS		OTHER BARS		TOP BARS		OTHER BARS	
	A	B	A	B	A	B	A	B
#3	22"	28"	17"	22"	19"	24"	15"	19"
#4	29"	37"	22"	29"	25"	32"	19"	25"
#5	36"	47"	28"	36"	31"	40"	24"	31"
#6	43"	56"	33"	43"	37"	48"	29"	37"
#7	63"	81"	48"	63"	54"	70"	42"	54"
#8	72"	93"	55"	72"	62"	80"	48"	62"
#9	81"	105"	62"	81"	70"	91"	54"	70"
#10	91"	118"	70"	91"	79"	102"	61"	79"
#11	101"	131"	78"	101"	87"	113"	67"	87"

1) TOP BARS ARE HORIZONTAL REINFORCEMENT WITH MORE THAN 12" OF CONCRETE CAST BELOW THE REINFORCEMENT.
 2) MASONRY REINFORCING LAP SPLICE LENGTHS SHALL BE 48x BAR DIAMETER.

BRICK LINTEL SCHEDULE	
MAXIMUM OPENING WIDTH	STEEL FOR EACH 4" OF WALL THICKNESS
4'-0"	L5x5x5/16
6'-0"	L5x5x5/16
8'-0"	L5x5x3/8
12'-0"	L7x4x3/8 (LLV) W/ 1/4" CLOSURE PLATE

AT ARCHED OPENINGS, ROLL ANGLE TO RADIUS SHOWN ON ARCH'D DWGS. MITER & WELD 8" LENGTH OF ANGLE HORIZ. EACH END FOR BEARING.